

HOURLY RATING:


2-HOUR

FIRE DESIGN REFERENCE:

ITS WHI GP/WA 120-01, GA WP 7054.4

STC RATING:

50-54

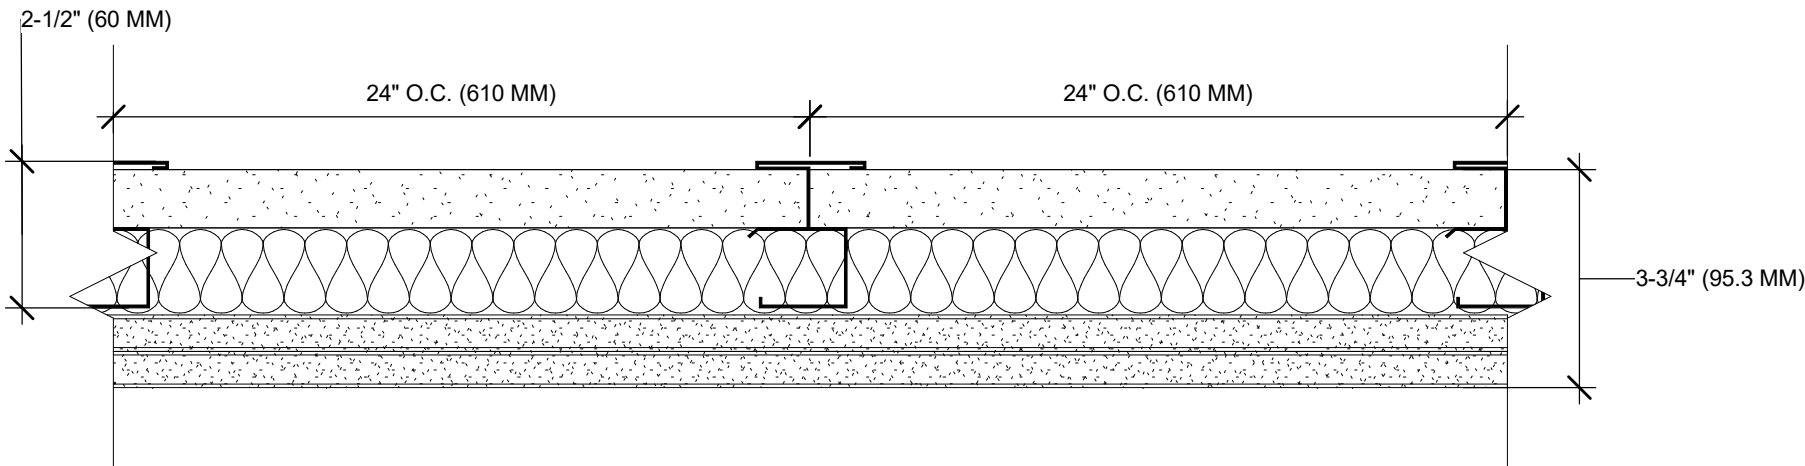

ASSEMBLY DETAILS:

ONE (1) LAYER TOUGHROCK® OR DENSGLOSS® SHAFTLINER INSERTED BETWEEN 2-1/2" FLOOR AND CEILING J RUNNERS OF 2-1/2" C-H, C-T, OR I STEEL STUDS BETWEEN PANELS.

OPPOSITE SIDE:
BASE LAYER 1/2" TOUGHROCK® FIREGUARD C® OR 1/2" DENSARMOR PLUS® FIREGUARD C® INTERIOR PANELS APPLIED PERPENDICULAR TO ONE SIDE OF STUDS WITH 1" TYPE S SCREWS SPACED 24" O.C.

FACE LAYER 1/2" TOUGHROCK® FIREGUARD C® OR 1/2" DENSARMOR PLUS® FIREGUARD C® INTERIOR PANELS APPLIED PARALLEL TO FRAMING WITH 1-5/8" TYPE S SCREWS 24" O.C. ALONG TOP AND BOTTOM TRACKS AND 12" O.C. AT VERTICAL JOINTS AND INTERMEDIATE STUDS. FACE LAYER JOINTS STAGGERED 24" FROM BASE LAYER.

SOUND TEST REFERENCE:

RAL TL09-360
SOUND TESTED WITH 21 MIL C-T STUDS & 1-1/2" GLASS FIBER INSULATION IN STUD CAVITY.

APPROVED FOR ASSEMBLY:

- 1" TOUGHROCK® SHAFTLINER
- 1" DENSGLOSS® SHAFTLINER
- 1/2" DENSARMOR PLUS® FIREGUARD® C INTERIOR PANEL
- 5/8" DENSARMOR PLUS® FIREGUARD® C INTERIOR PANEL
- 1/2" TOUGHROCK® FIREGUARD® C GYPSUM BOARD
- 5/8" TOUGHROCK® FIREGUARD® C GYPSUM BOARD

SHAFTWALL
RATING - 2 HOUR

GEORGIA-PACIFIC
BUILDING PRODUCTS
133 PEACHTREE ST NE
ATLANTA, GA 30303
1-800-225-6119
WWW.BUILDGP.COM

ISSUED DATE

GP-SW-04



©2023 GEORGIA-PACIFIC GYPSUM LLC AND GEORGIA-PACIFIC WOOD PRODUCTS LLC. ALL RIGHTS RESERVED.
IMPORTANT -This document is presented for illustration and use by design professionals for planning. It should not be used for construction. Consult the fire resistance directory or report for complete information. The STC Rating reflects evaluation of an assembly under test conditions and may not apply to all products listed. For products manufactured by third parties, contact the manufacturer for installation instructions. Ultimately, design and detailing are the responsibility of a professional, and projects must comply with applicable codes and standards. GP Gypsum makes no representation or warranty, express or implied, concerning this information.
FIRE SAFETY CAUTION – Passing a fire test in a controlled laboratory setting or identifying a product as having an hourly fire resistance rating and, therefore, as acceptable for use in certain fire rated assemblies, does not mean that the assembly or product will provide the specified hourly fire resistance in an actual fire. In the event of an actual fire, you should immediately take any actions necessary for the safety of you and others without regard to any fire rating. Please visit www.buildgp.com/safetyinfo.